

Figure PA 1

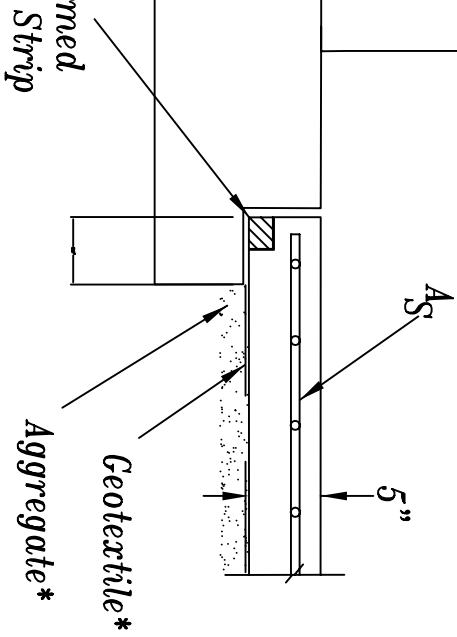


Figure PA 2

Distance Between Joints	For 5" Thick Floor	
	A _S	Example
< 30'	.029	6x6-W1.4xW1.4
> 30'	.058	6x6-W2.9xW2.9

* As Specified

- NOTES**
1. Minimum 3 feet of backfill over top of footing for frost protection.
 2. Type I or Type II cement is acceptable.
 3. Drainage with 4" CPT (or equivalent) around the tank to an outlet is required.
 4. Adhesive should be used to keep bentonite strip in place during floor pour. Tacks/nails should be avoided which may create hard-point contact and cause concrete to spall.
 5. See PA-064 for dimension "B".

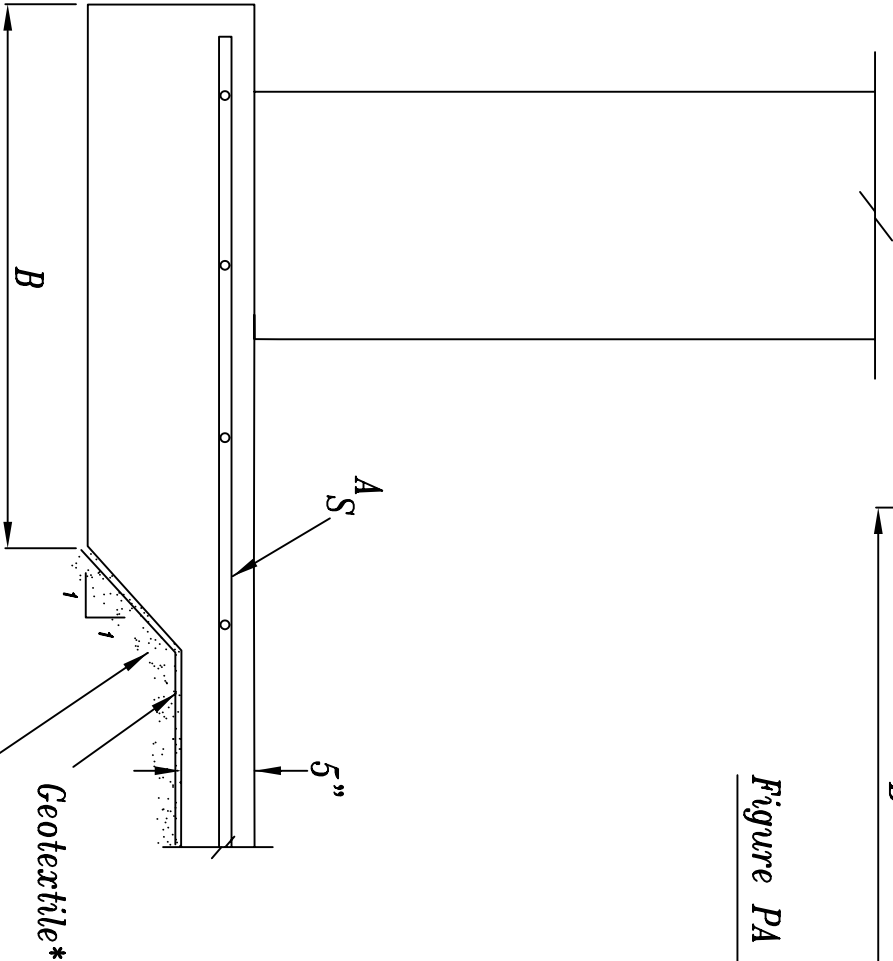


Figure PA 3